


X-RAY: 0 - 20 keV
Live: 123s Preset: 225s Remaining: 102s
Real: 191s 35% Dead Rate 3387 cps

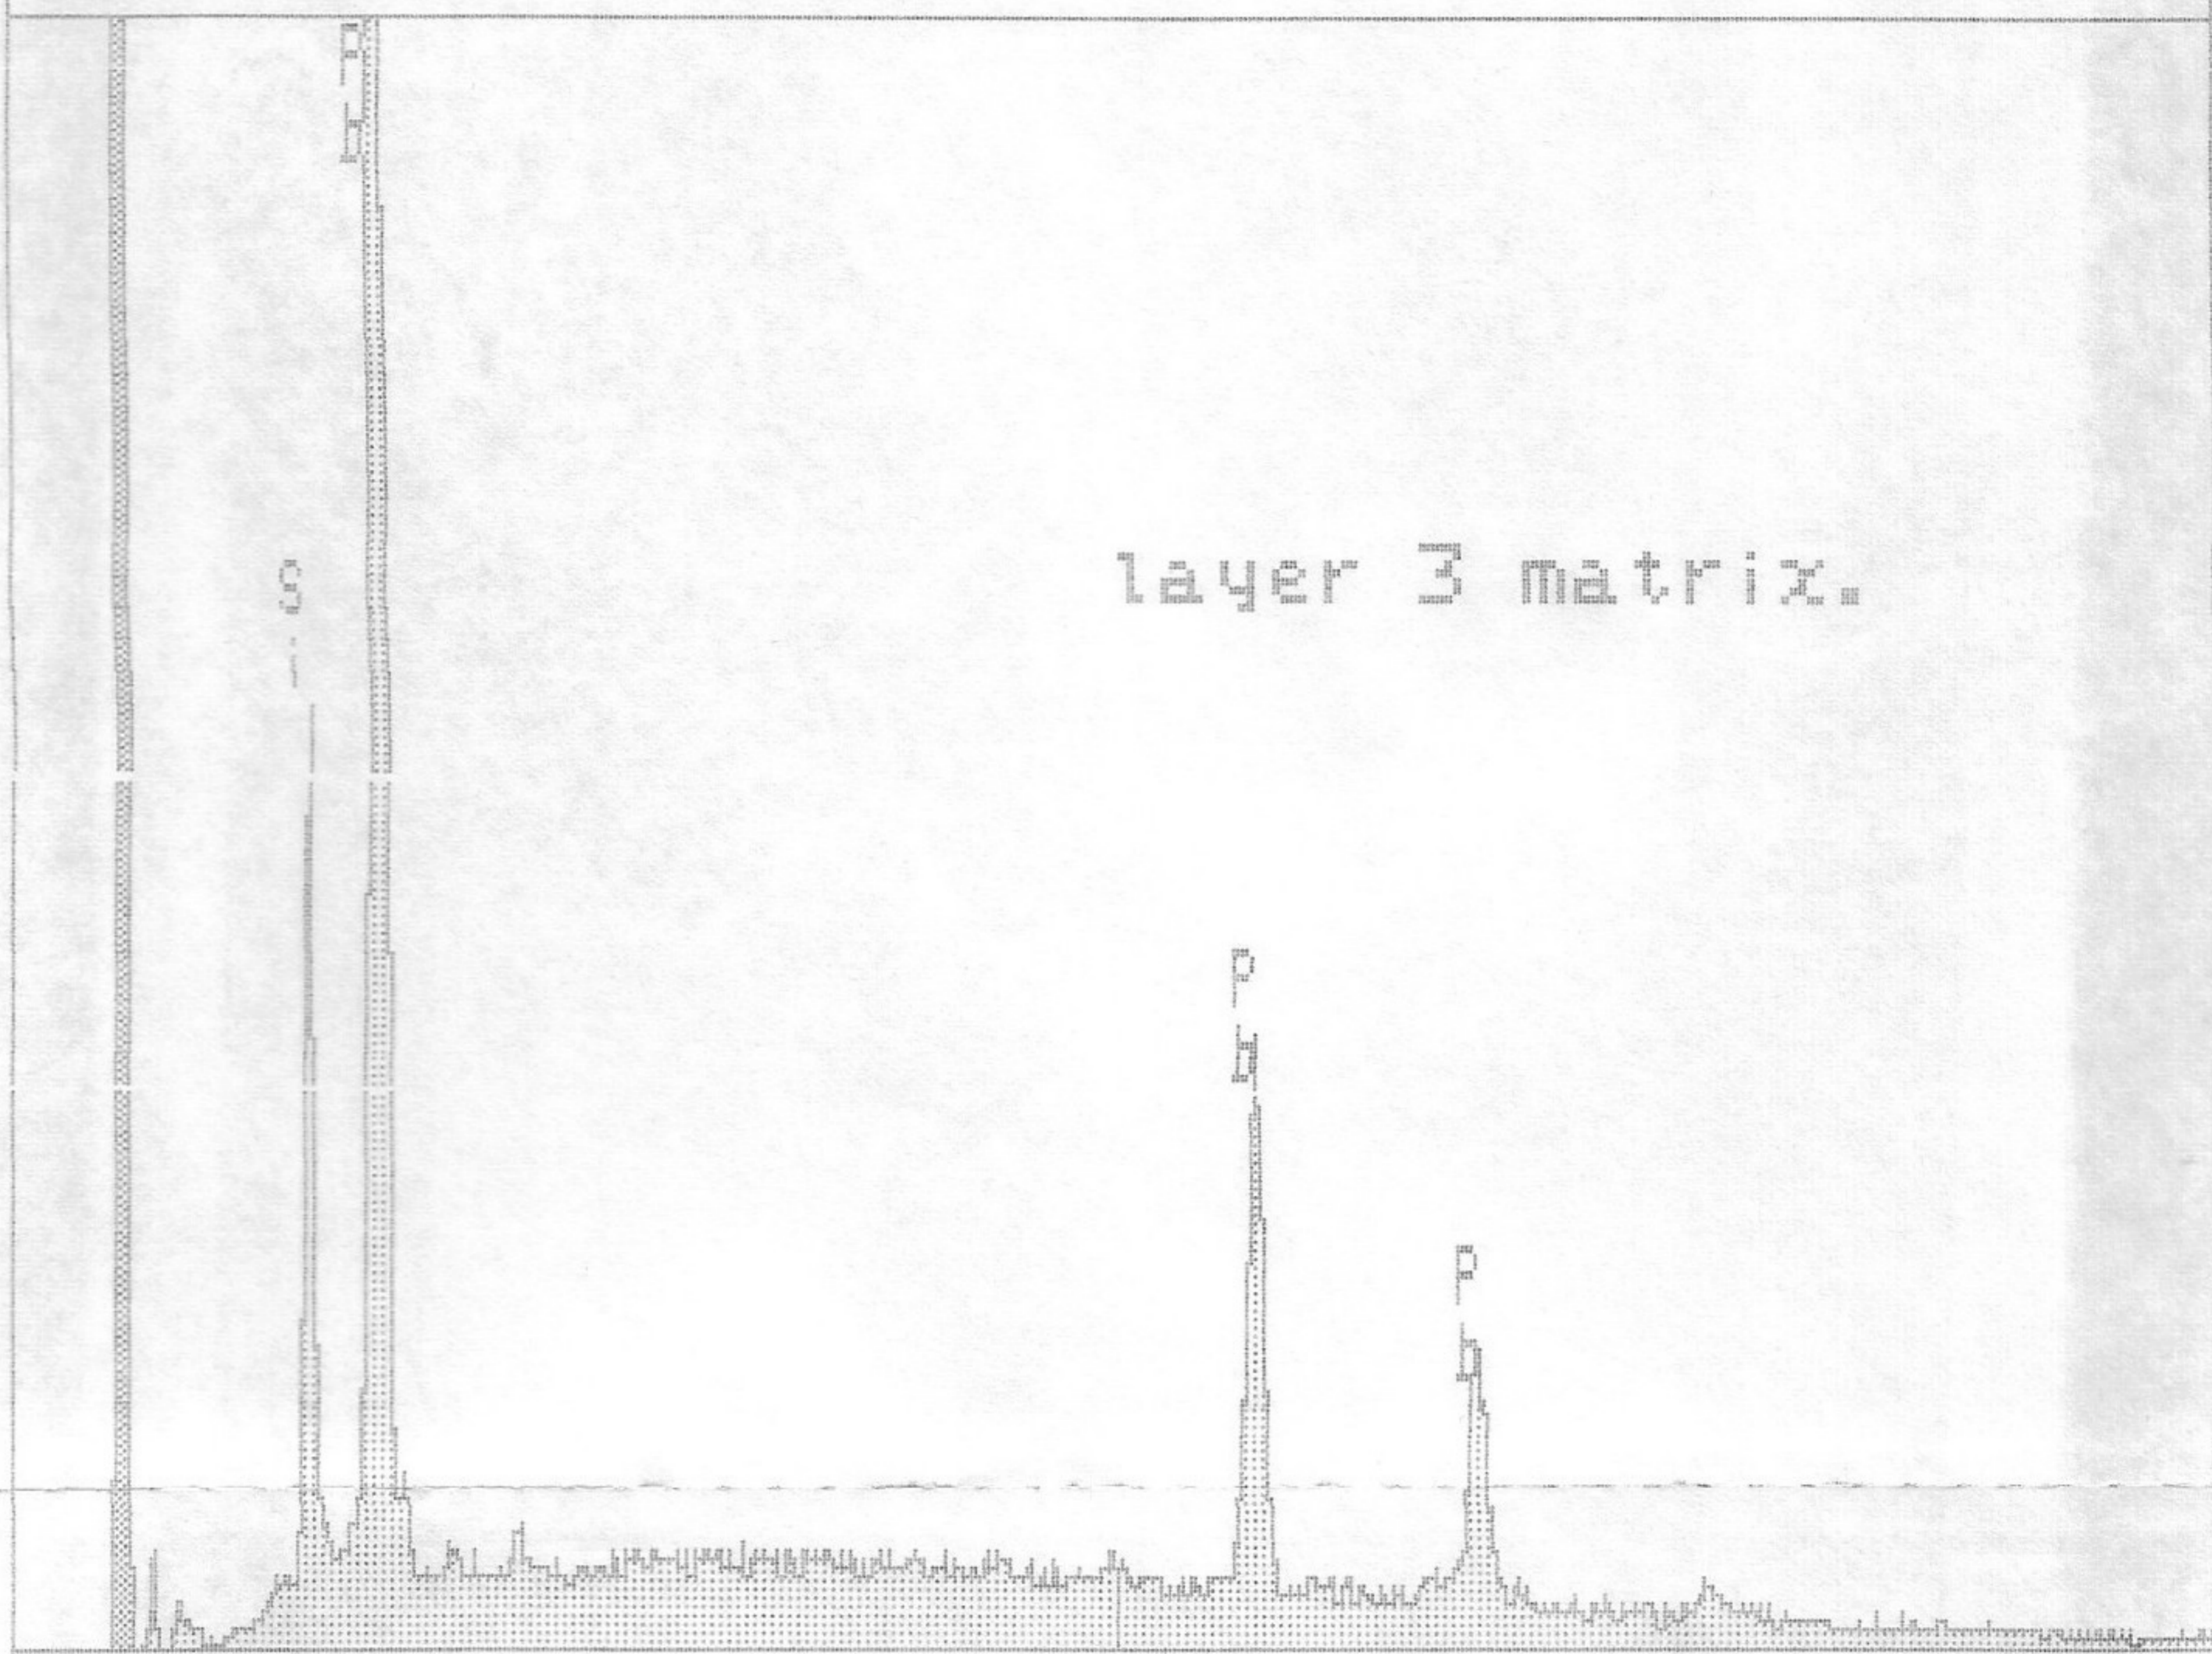

9.220 keV 19.5 >
FOI BK ch 471 = 113 cts
MEM: 0.131