


X-RAY: 0 - 20 keV
Live: 80s Preset: 225s Remaining: 145s
Real: 110s 32% Dead

layer 2 upper dark flesh
layer adam's arm.

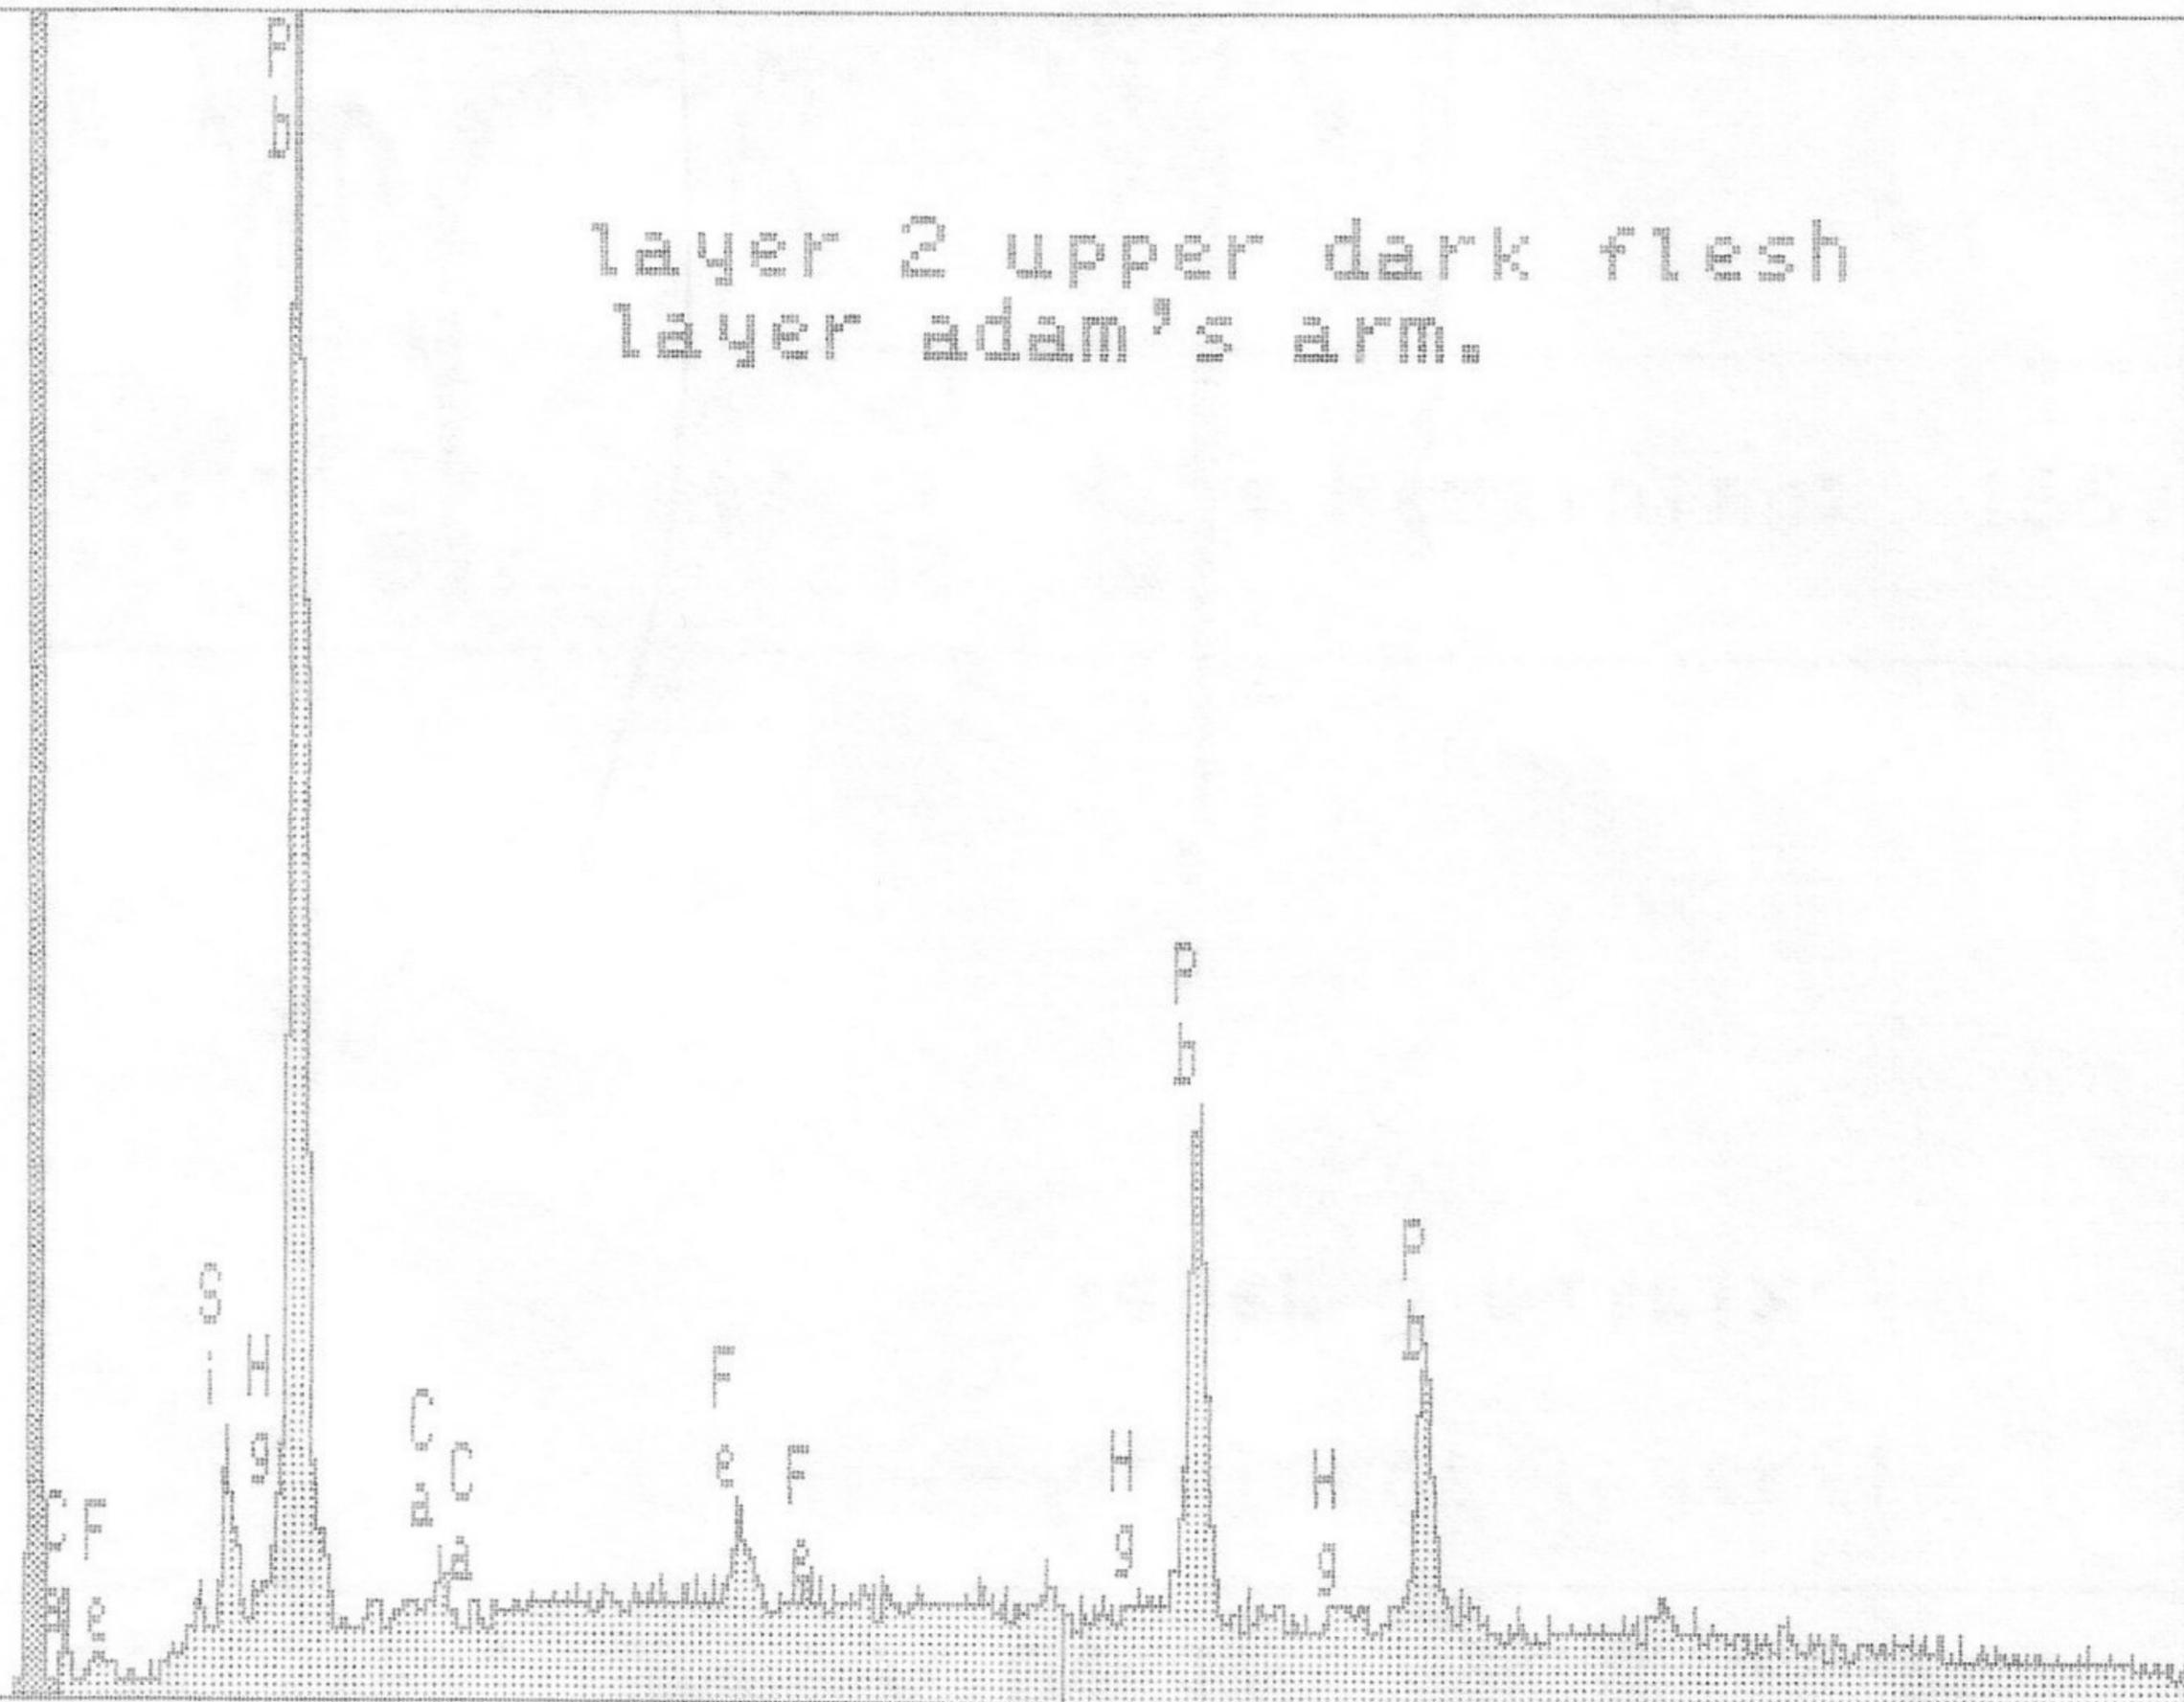

9.300 keV 19.5 >
FS= 1K 08= 16 ch 475= 55 cts
MENU: s. 2011 cranach adam/e CG flesh